




Water Department Report

As of May 31, 2019

City of Garden Ridge Well Usage

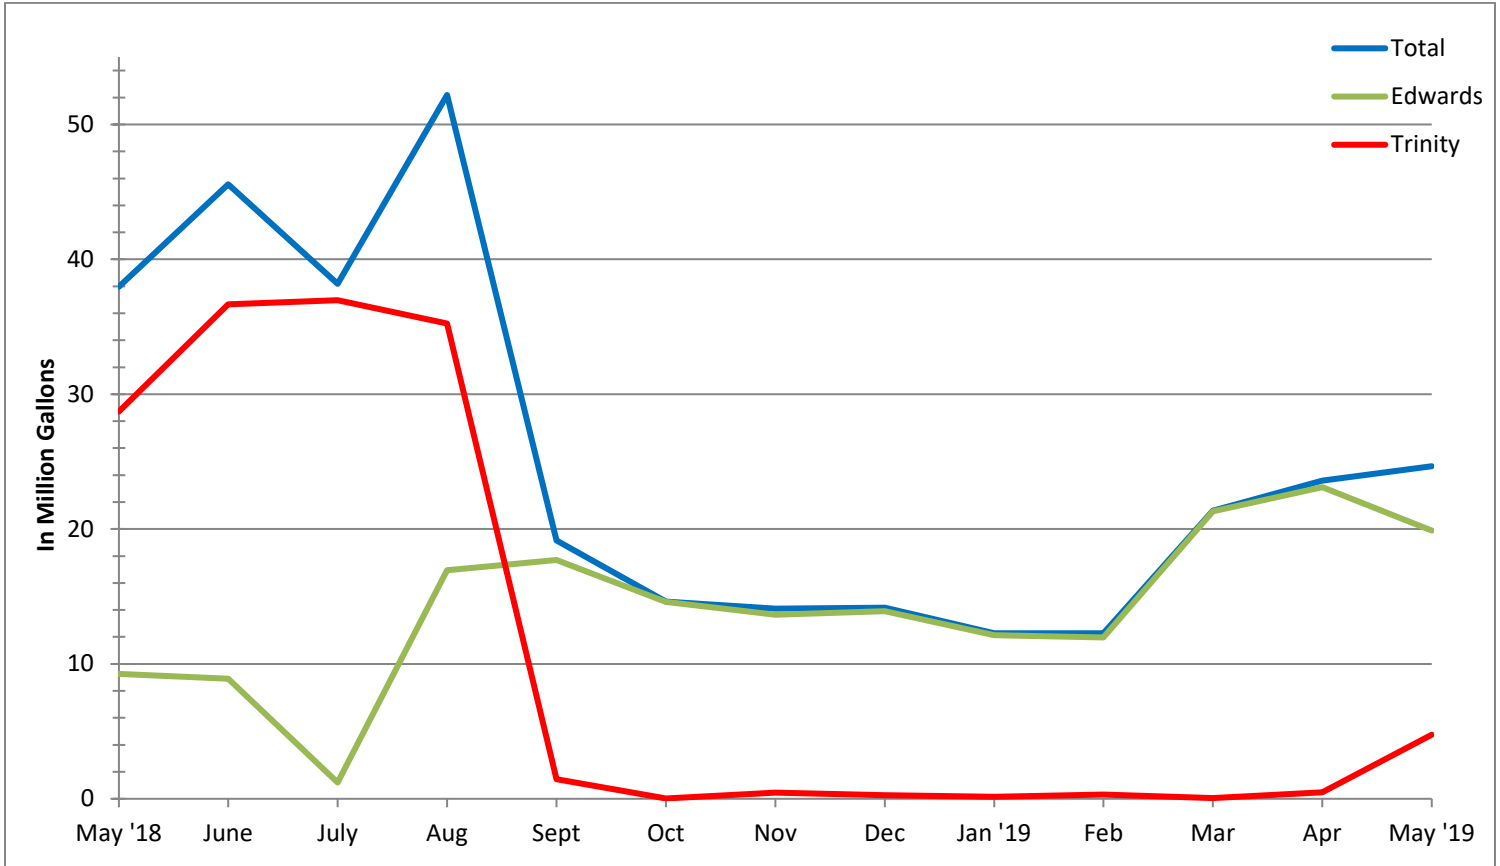


	Month:	Year:	Available:	Stage:
Edwards Well Usage AC/FT:	61.01	200.35	511.94	0
Trinity Well Usage AC/FT:	14.61	16.16	N/A	- 0%

Water Quality

	Due:	Missed:	Passed:	Failed:
Bacteriological:	6	0	6	0
Raw:	4	0	4	0
Chlorine Residual Test:	31	0	31	0

2018 – 2019 Pumping Report

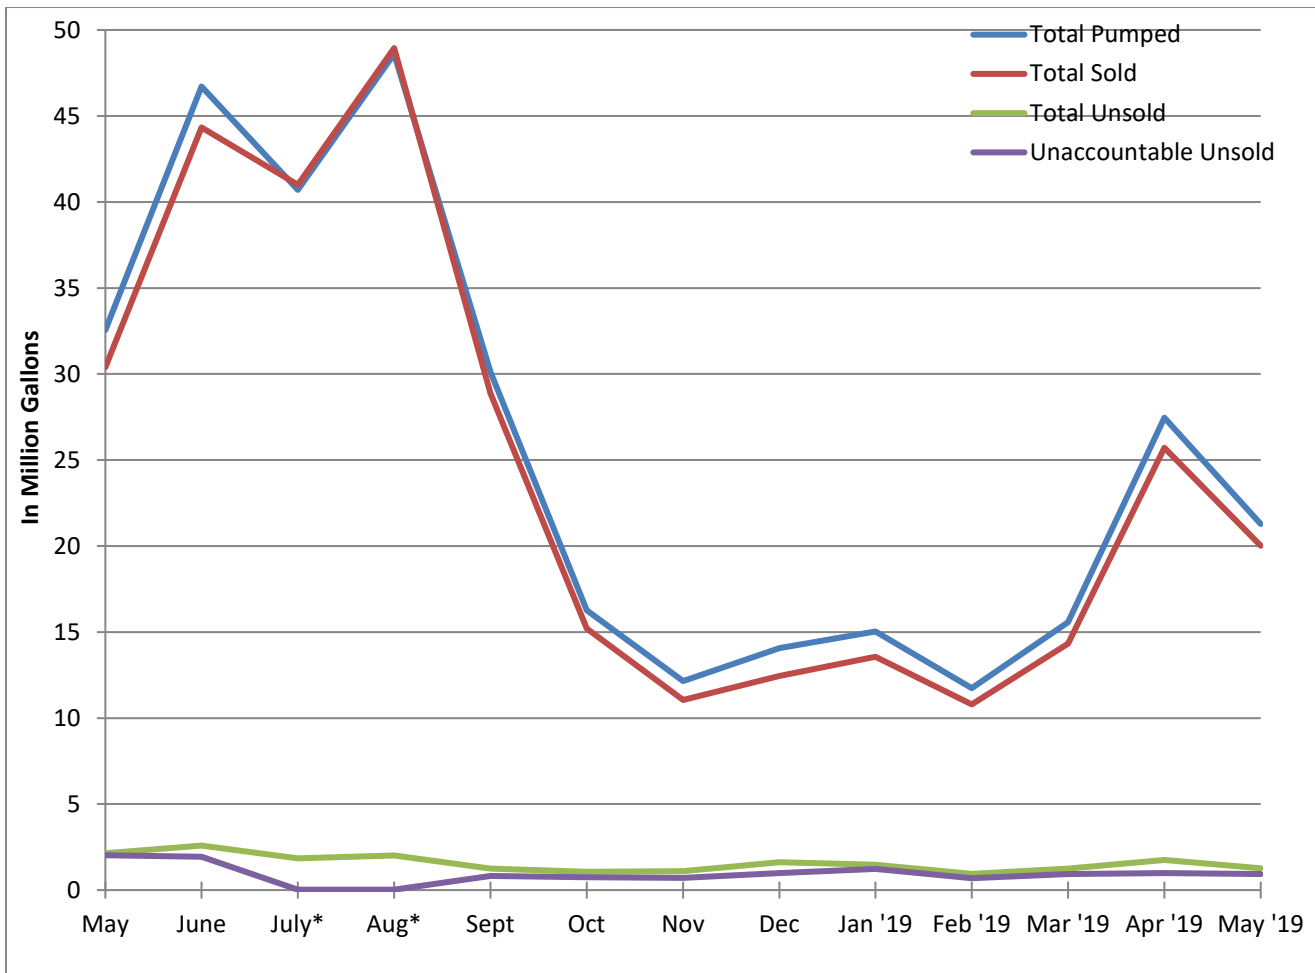

	Total Pumped (Thousands)	Total Sold (Thousands)	Total Unsold (Thousands)	Unaccountable Unsold (Thousands)	Unaccountable Unsold %
May '18	32,555	30,405	2,150	2,026	6.2%
June	46,719	44,332	2,587	1,939	4.2%
July*	40,697	41,002	1,842	26	0.1%
Aug*	48,604	48,945	2,009	26	0.1%
Sept	30,118	28,871	1,247	820	2.7%
Oct	16,256	15,198	1,058	749	4.6%
Nov	12,153	11,057	1,096	703	5.8%
Dec	14,073	12,447	1,626	998	7.1%
Jan '19	15,035	13,556	1,479	1,228	8.2%
Feb '19	11,738	10,795	943	691	5.9%
Mar '19	15,572	14,324	1,248	937	6.0%
Apr '19	27,464	25,712	1,752	985	3.6%
May '19	21,278	20,016	1,262	899	4.2%

* July and August inaccurate due to inaccuracy of new meters at 3009 wellsite at time.

Water Department Monthly Activities:

New Meter Installs	1	Work Orders	50
Meter Replacements	2	Locates	39
City Owned Leaks	3	Irrigations Permits Issued	2
Meters Read May 2019	1,645	Total Rebates	0

Maintenance:

- Vehicle Inspections
- Generator Inspections
- Pump & Motor Inspections

Projects:

- Implementing Field Force Management for more efficient everyday operations.
- Fire Extinguishers put in MCC rooms at all well sites.
- Fixed 2 Fire Hydrants

Employee Updates:

This month we had a fire hydrant repair education training which resulted in two fire hydrants being rebuilt in house. Water Master came out and taught us how to rebuild and maintain their brand of fire hydrants leaving tools for us to use in such cases. The team is working well together to take care of the everyday tasks and they are open to learning new things. I am very proud of them.