




Water Department Report

As of September 30, 2019

City of Garden Ridge Well Usage

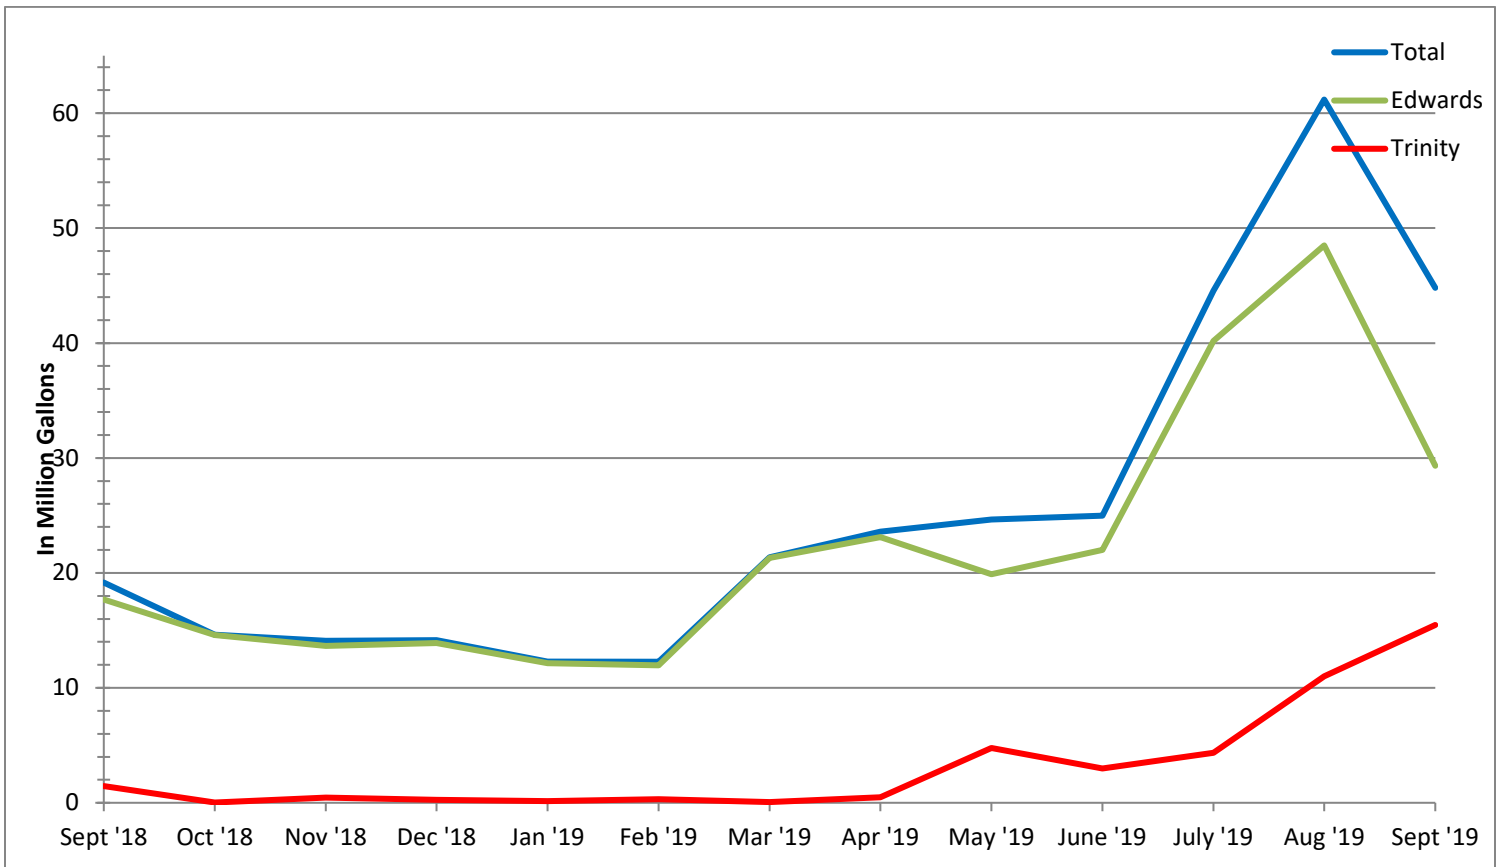


	Month:	Year:	Available:	Stage:
Edwards Well Usage AC/FT:	89.98	702.04	10.15	0
Trinity Well Usage AC/FT:	47.48	119.92	N/A	- 0%

Water Quality

Bacteriological:	6	0	6	0
Raw:	4	0	4	0
Chlorine Residual Test:	30	0	30	0

2018 – 2019 Pumping Report

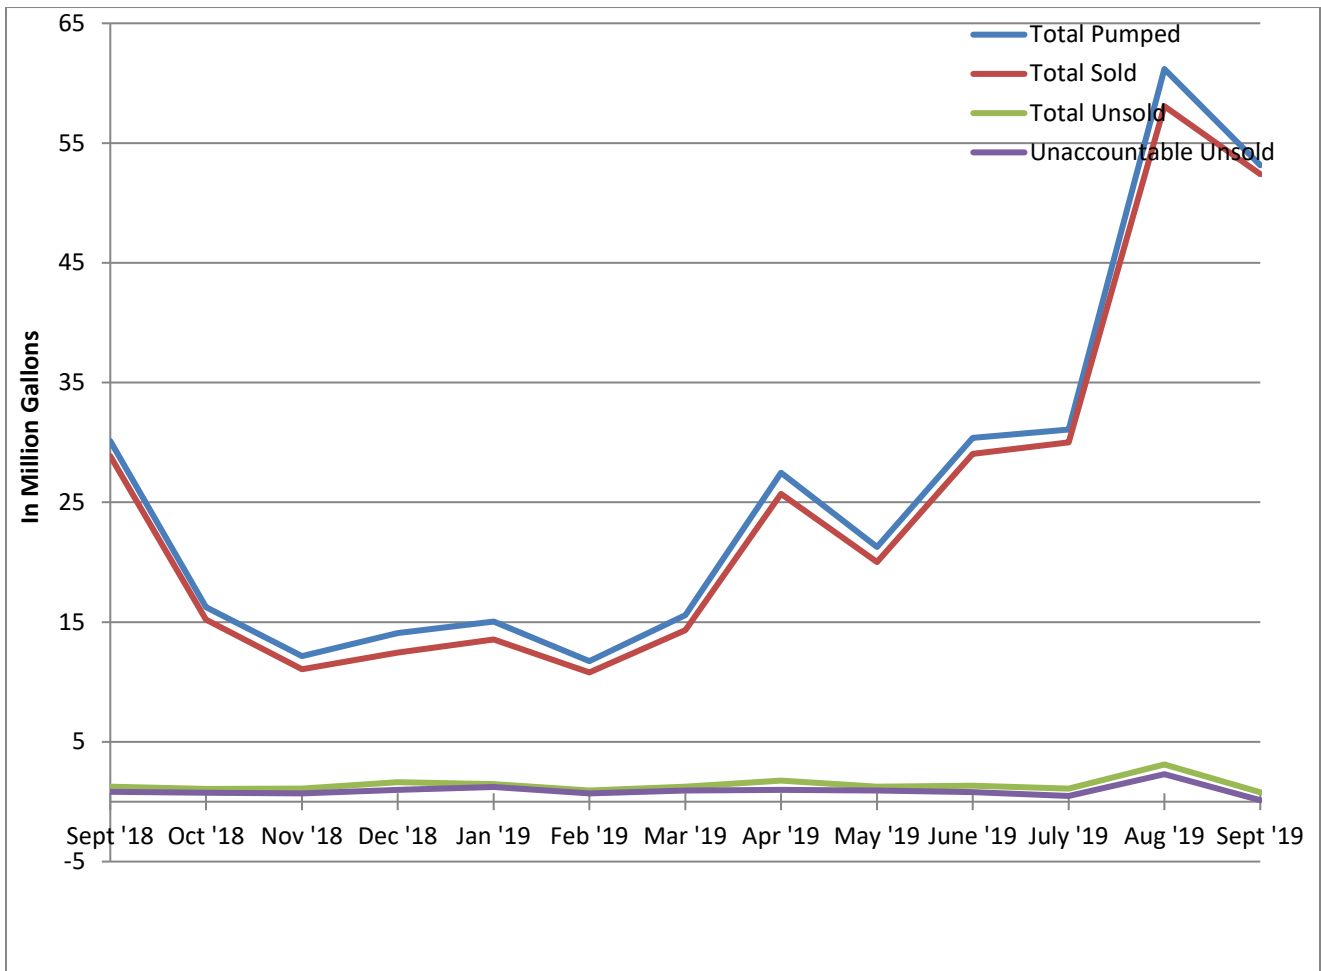

	Total Pumped (Thousands)	Total Sold (Thousands)	Total Unsold (Thousands)	Unaccountable Unsold (Thousands)	Unaccountable Unsold %
Sept '18	30,118	28,871	1,247	820	2.7%
Oct '18	16,256	15,198	1,058	749	4.6%
Nov '18	12,153	11,057	1,096	703	5.8%
Dec '18	14,073	12,447	1,626	998	7.1%
Jan '19	15,035	13,556	1,479	1,228	8.2%
Feb '19	11,738	10,795	943	691	5.9%
Mar '19	15,572	14,324	1,248	937	6.0%
Apr '19	27,464	25,712	1,752	985	3.6%
May '19	21,278	20,016	1,262	899	4.2%
June '19	30,391	29,047	1,343	802	2.6%
July '19	31,078	29,996	1,082	475	1.5%
Aug '19	61,184	58,074	3,110	2,298	3.8%
Sept '19 *	53,145	52,395	786	125	0.2%

* September water loss is off due to inaccuracy of the Schoenthal well master meter.

Water Department Monthly Activities:

New Meter Installs	6	Work Orders	379
Meter Replacements	2	Locates	23
City Owned Leaks	1	Irrigations Permits Issued	1
Meters Read May 2019	1,648	Total Rebates	1

Projects:

- Whispering Oaks Project is Ongoing
- Meter Testing and Laptop Readings
- Chris Graef Took a Backflow & Assembly Class
- Cl2 Scales have been installed
- National Night Out

Meters Flow Tested	Passed	Failed
103	all	None

Laptop readings	Analyzed	Possible Leaks
135	122	34