




Water Department Report

As of January 31, 2020

City of Garden Ridge Well Usage

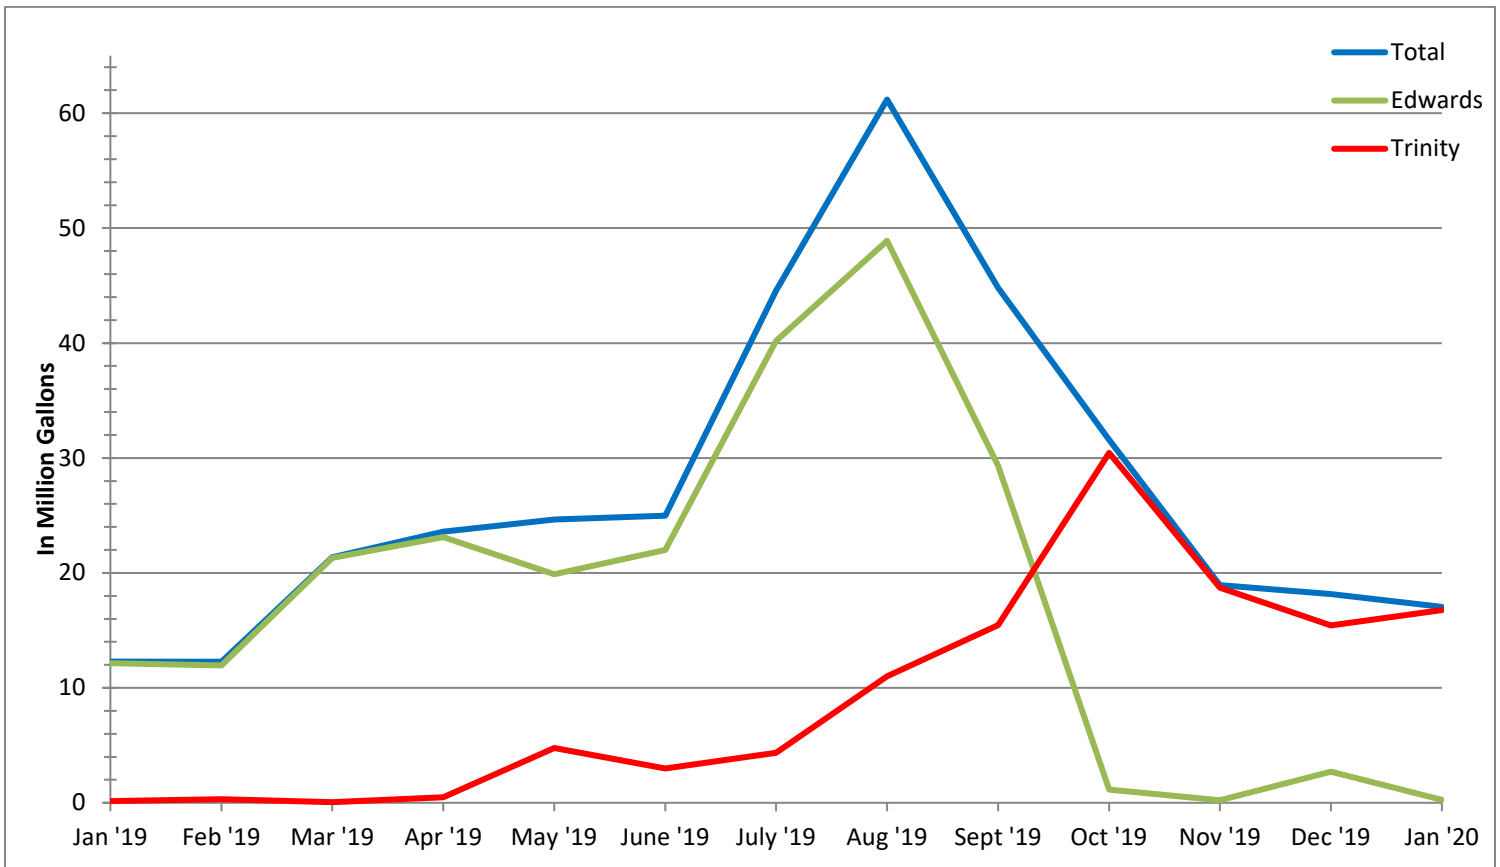


	Month:	Year:	Available:	Stage:
Edwards Well Usage AC/FT:	0.93	0.93	715.66	0
Trinity Well Usage AC/FT:	51.50	51.50	N/A	0%

Water Quality

	Due:	Missed:	Passed:	Failed:
Bacteriological:	6	0	6	0
Raw:	4	0	4	0
Chlorine Residual Test:	31	0	31	0

2018 – 2019 Pumping Report

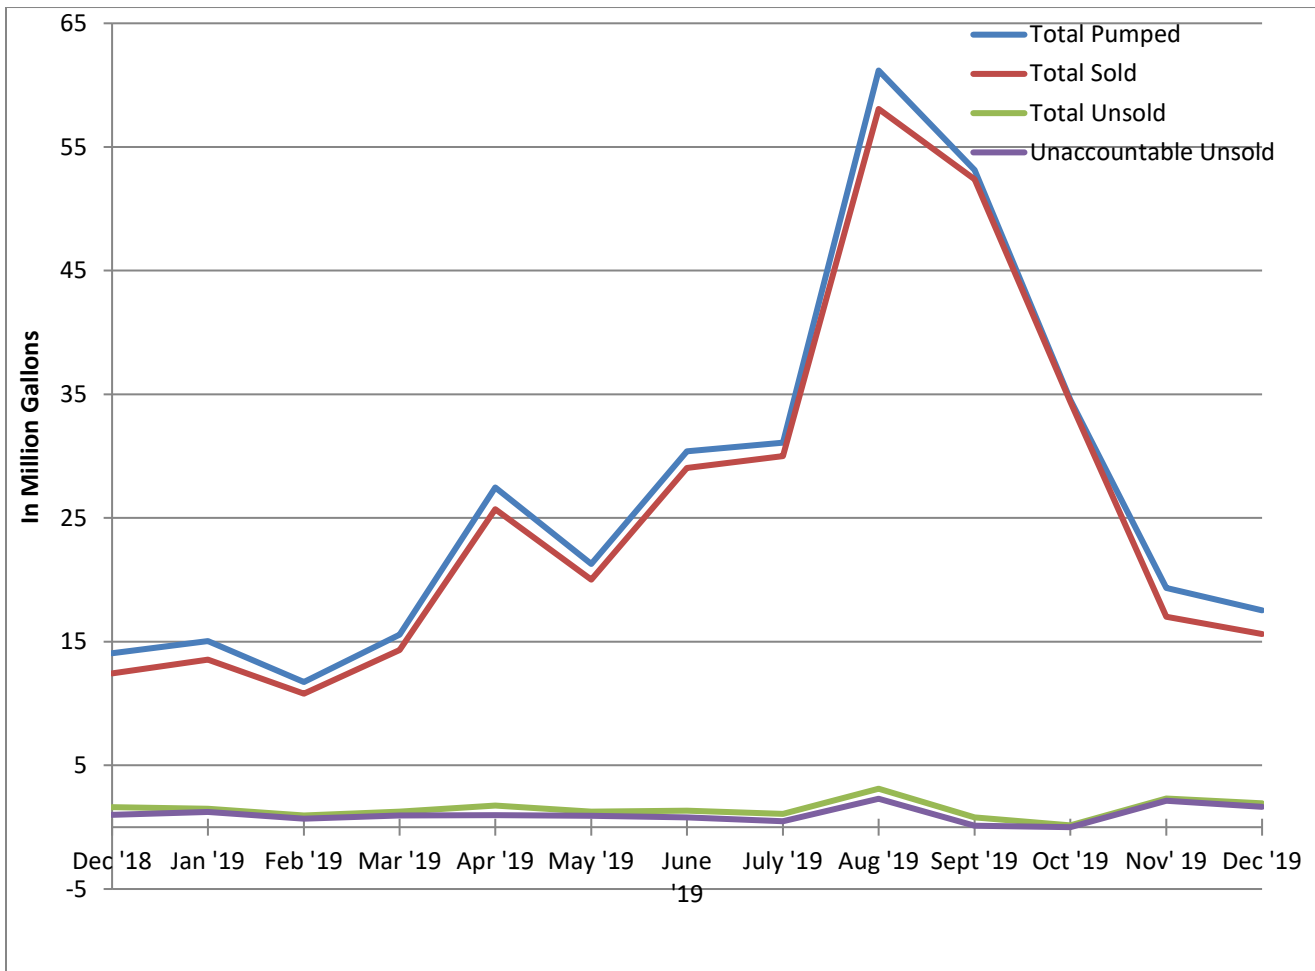

	Total Pumped (Thousands)	Total Sold (Thousands)	Total Unsold (Thousands)	Unaccountable Unsold (Thousands)	Unaccountable Unsold %
Jan '19	15,035	13,556	1,479	1,228	8.2%
Feb '19	11,738	10,795	943	691	5.9%
Mar '19	15,572	14,324	1,248	937	6.0%
Apr '19	27,464	25,712	1,752	985	3.6%
May '19	21,278	20,016	1,262	899	4.2%
June '19	30,391	29,047	1,343	802	2.6%
July '19	31,078	29,996	1,082	475	1.5%
Aug '19	61,184	58,074	3,110	2,298	3.8%
Sept '19 *	53,145	52,395	786	125	0.2%
Oct '19 *	34,551	34,405	146	0	0.0%
Nov '19	19,344	17,022	2,322	2,149	11.1%
Dec '19	17,527	15,610	1,917	1,657	9.5%
Jan '20	17,956	16,308	1,648	1,388	7.7%

* September water loss is off due to inaccuracy of the Schoenthal well master meter.

Water Department Monthly Activities:

New Meter Installs	0	Work Orders	137
Meter Replacements	5	Locates	10
City Owned Leaks	1	Irrigations Permits Issued	2
Meters Read	1,674	Total Rebates	0
Meter Tests	6	Laptop Readings	10

Leak Adjustments

New Requests	2	Waiting for Customer	8	Approved	2	Amount Approved	\$17.97	Denied	0	Sent to Water Commission	0
--------------	---	----------------------	---	----------	---	-----------------	---------	--------	---	--------------------------	---

Projects:

- Whispering Oaks Project is Ongoing
- AMI/AMR System Prices
- Work Order Data Retention
- Cleaning the Well Sites
- Cl-10 Installation